



Insights From Optimizing Energy Storage Sizing and Dispatch

Vinayak Walimbe
VP, Emerging Technologies

Customized Energy Solutions



Customized Energy Solutions

Established in 1998, Customized Energy Solutions (CES) is a consulting and services company that assists clients in managing and staying ahead of the changes in the wholesale and retail electricity and natural gas markets. Serving hundreds of clients, Customized Energy Solutions offers best-in-class hosted energy market operations platforms and a wide spectrum of consulting services. CES is committed to promoting economic development through the advancement of transparent, efficient, and non-discriminatory wholesale and retail electricity and natural gas markets.

Presence

Headquartered
Philadelphia, PA



Over 200 Associates across 9 Regional offices in United States, Canada, India, Japan & Mexico. We support clients in all US 7 ISOs and RTO's

Resources

14,000 MW assets under
Active Management

400 MW Energy Storage
assets under
Management

Awards and Recognitions



Inc. 5000 – Eleven Time Honoree, Philadelphia 100 - 2001, 2004 – 2012, 2019
Best Places to work: 2014, 2016
2016 Energy Storage Association Brad Roberts Award Winner

Clients

500+ Clients
Worldwide



Our consulting services enables competitive suppliers, technology providers, marketers, utilities and customers to prosper through change, by turning knowledge into value

Market Operations and Optimization

Our 24 hour Market Operations Center (MOC) and Operations Control Center (OCC) provides full spectrum market scheduling and dispatch services to energy market participants. Our services include: Real Time Markets, Operations Strategy, RT Dispatch, Curtailment Management, Outage Coordination, Wind Turbine Monitoring, Wind Generation Forecasting, Optimization Strategies, and Solar Monitoring.




MOC

The MOC performs day-ahead offering, real-time generation scheduling, curtailment management, reserve and regulation offering and monitoring, and daily meter verification

OCC

The OCC monitors plant status through our in-house generation management system, communicates plant status changes to RTOs, dispatch to maximize revenue minimize risk, and pass telemetry information to ISOs

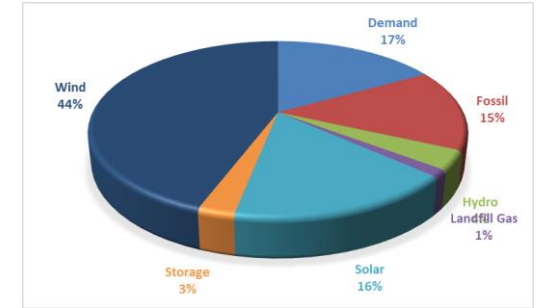


CES Portfolio 2020 – 14 GW+

CES currently manages over 400 MW of advanced energy storage resources in various wholesale markets through North America

GridBOOST: Bid-Offer Optimization Platform

- Energy Storage Asset Scheduling and Optimization platform provides multi-stack revenue optimization
- Optimizer accounts for market participation rules, storage technical constraints as well as degradation costs
- Platform optimizes revenue for grid-scale energy storage and RE integrated hybrid projects



Bids-Offers for a 10MW Storage Asset in CAISO

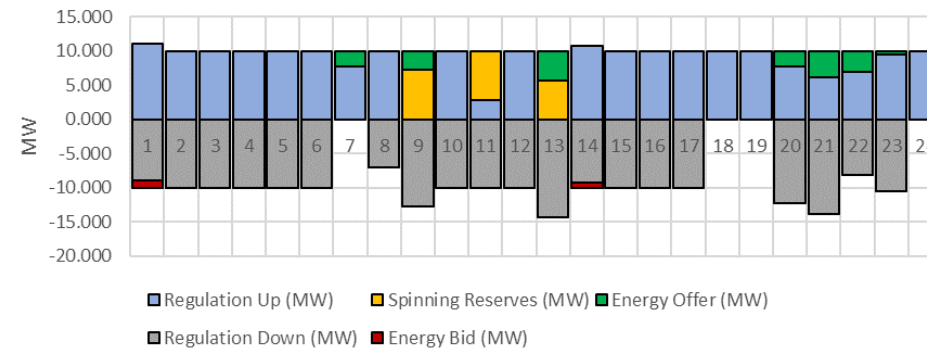

CES - CoMETS

Financial Decision Making Tool

Comprehensive Markets Evaluation Tools for Storage In-front-of-the-meter Module

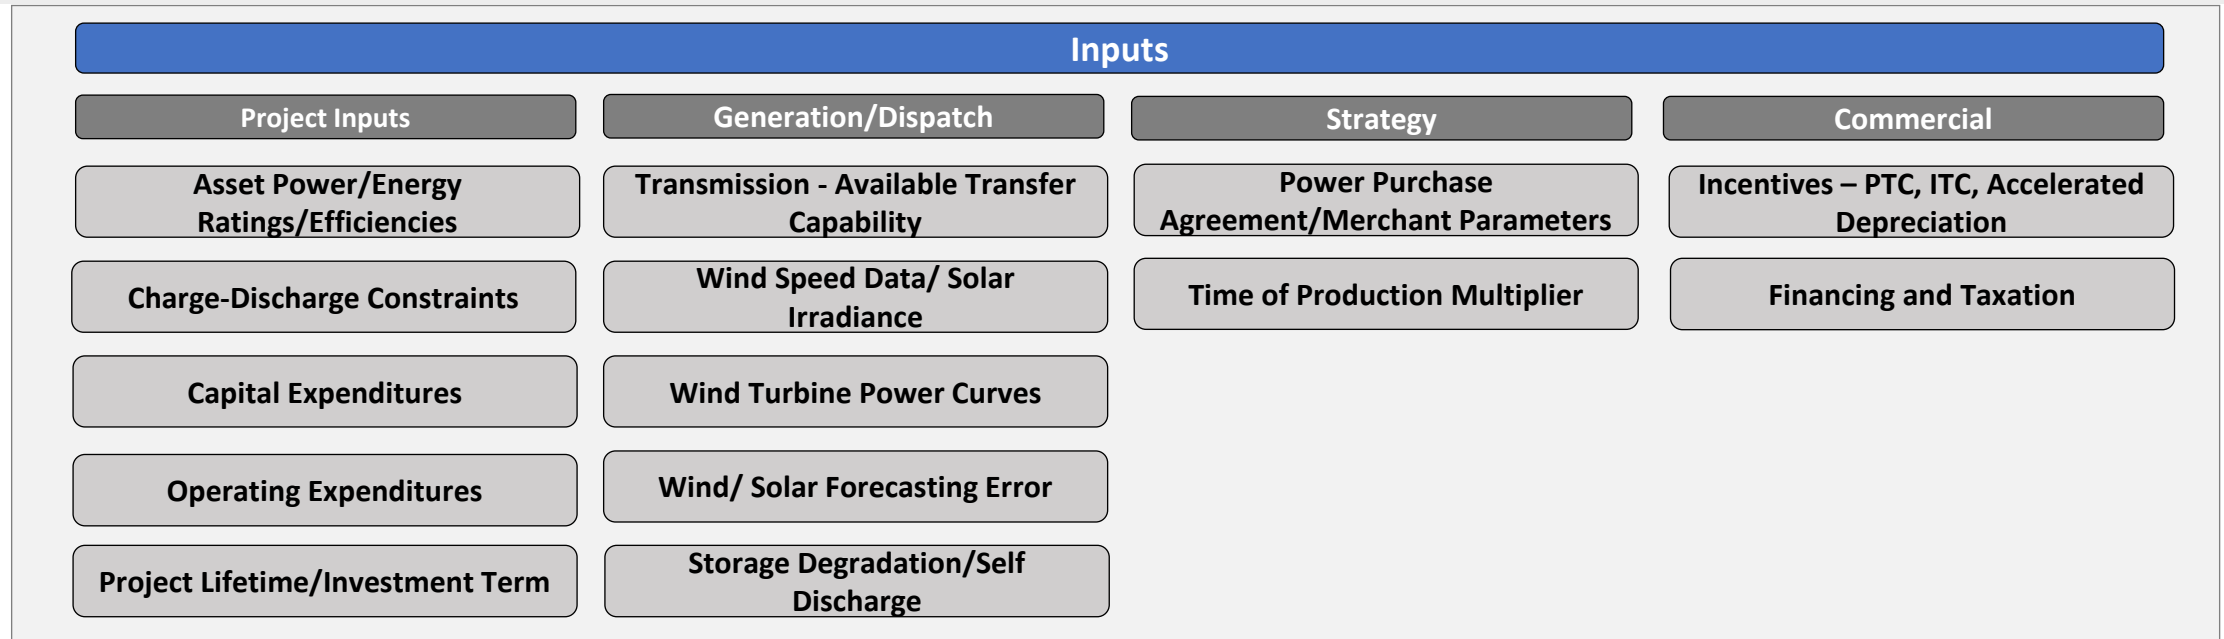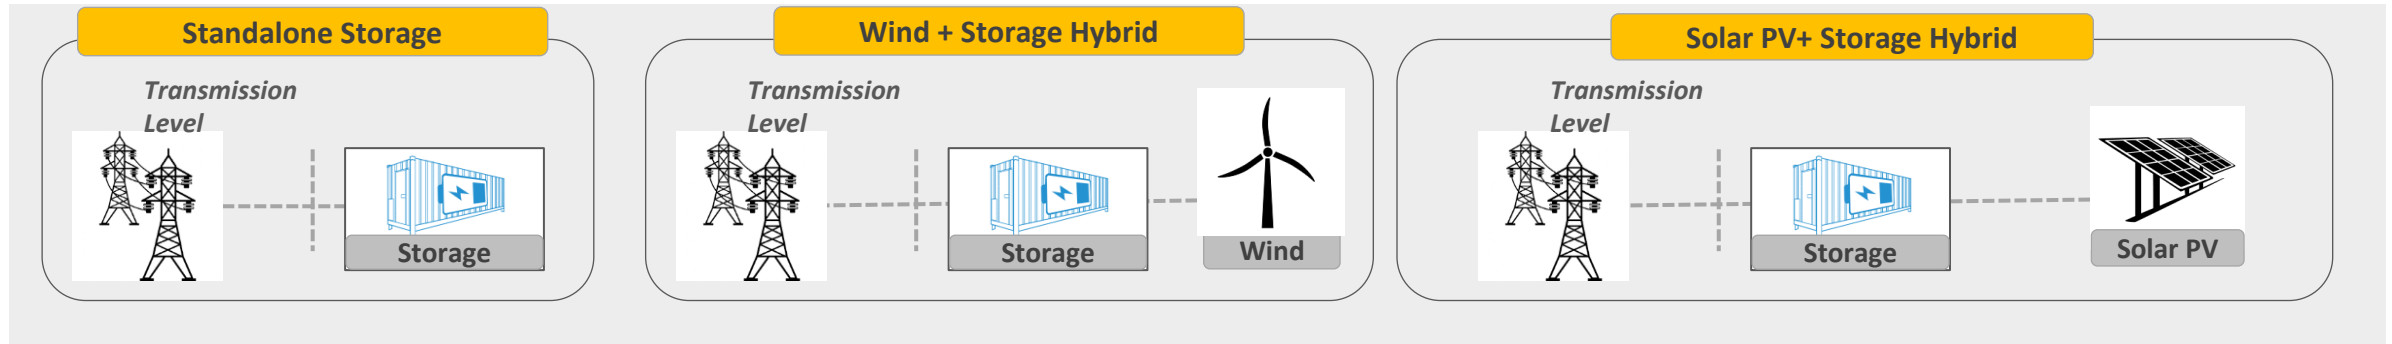


CoMETS: In-front-of-the-meter Module



CoMETS uses a mixed integer linear programming (MILP) based optimization engine to determine optimal hourly dispatch of the ESS in order to maximize potential market revenues subject to participation in various market segments and under relevant operating constraints.

Optimization Model ESS Dispatch(MWh) in Wholesale Markets

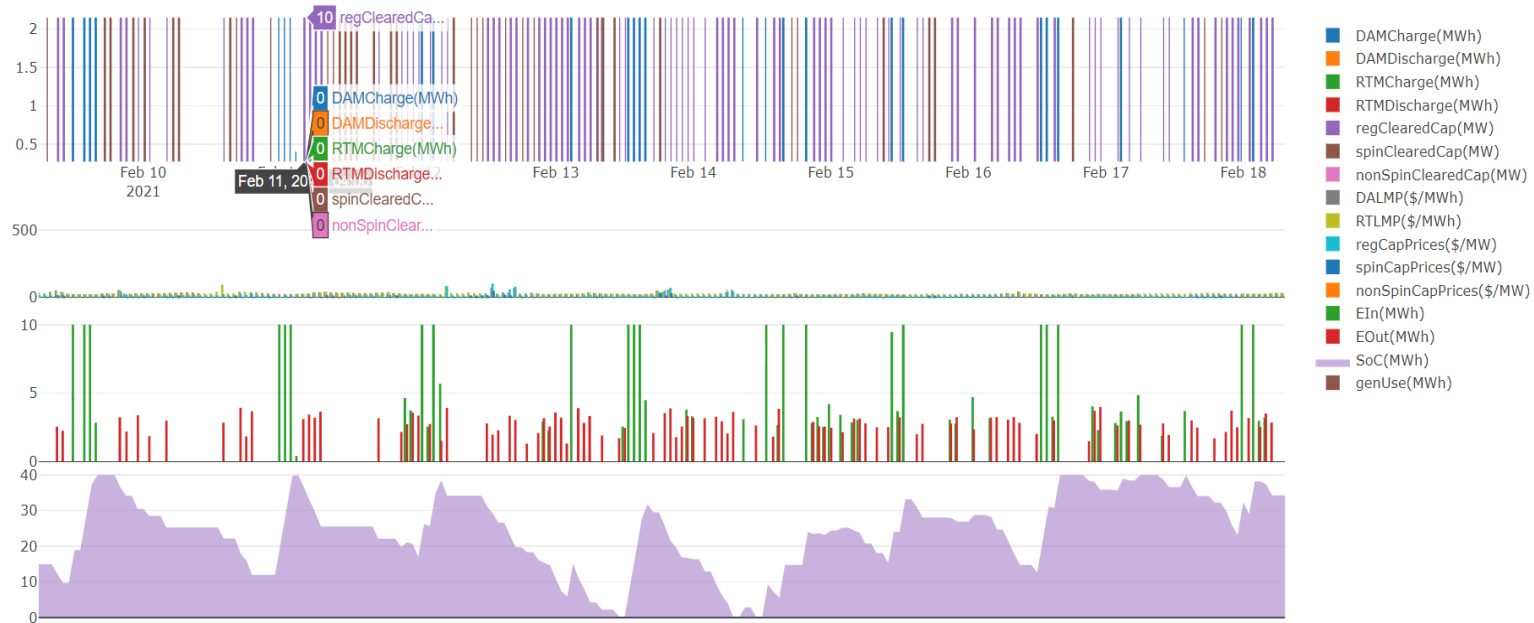

Key Features

Market Services Selection

RE Charging Limits

Operational Restrictions

Control DoD Cycles

Enforce Market Rules

Multi-Stack Hourly Dispatch

Long Term Revenues


* Charts are for representative purpose only

CES - GridBOOST




Operational Platform to Maximize the Value

GridBOOST - Operational Platform to Maximize Value of Storage

Why Optimization is Needed?

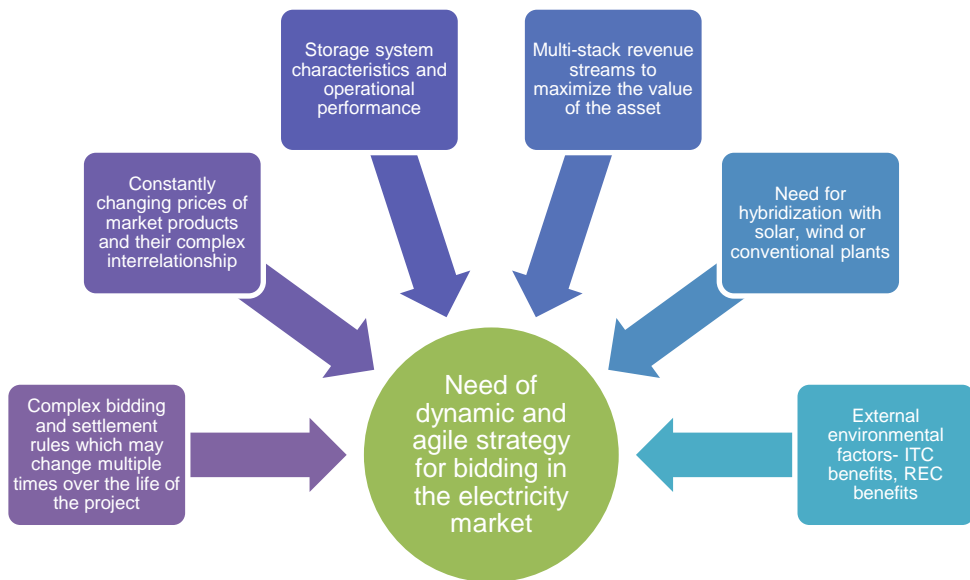


Bid Offer Optimization

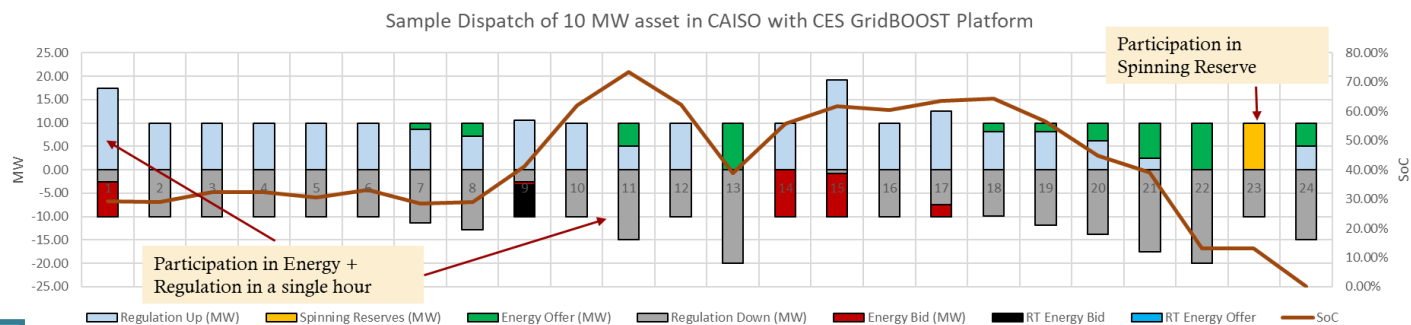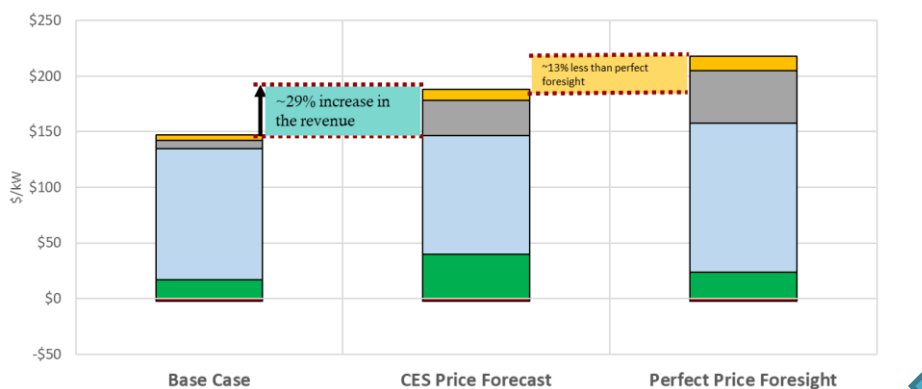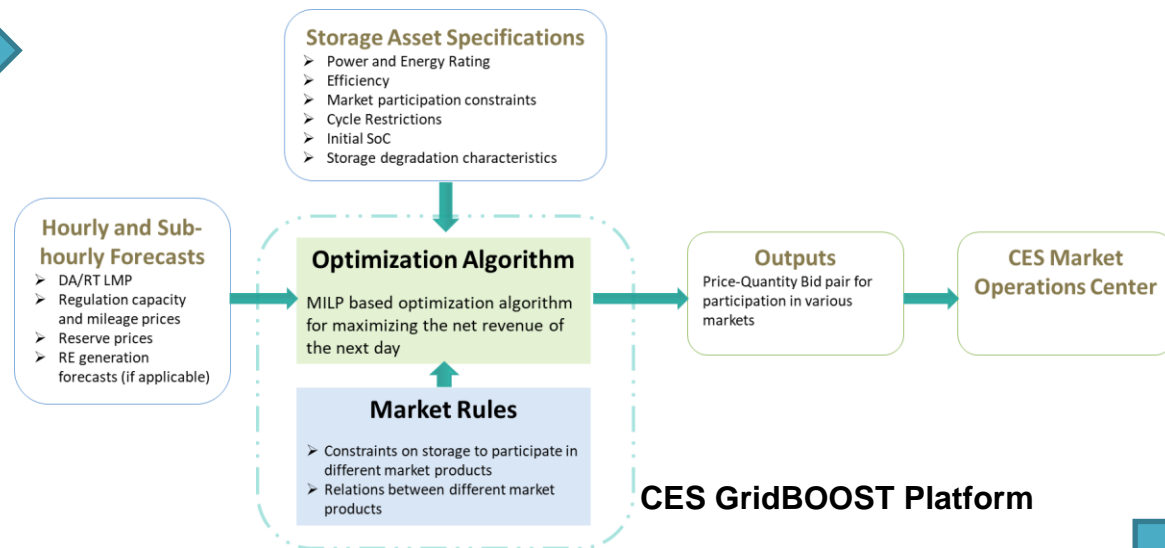

Production Cost Modeling

System Level Analysis

Power System Modeling Framework to Optimize System Level Aspects

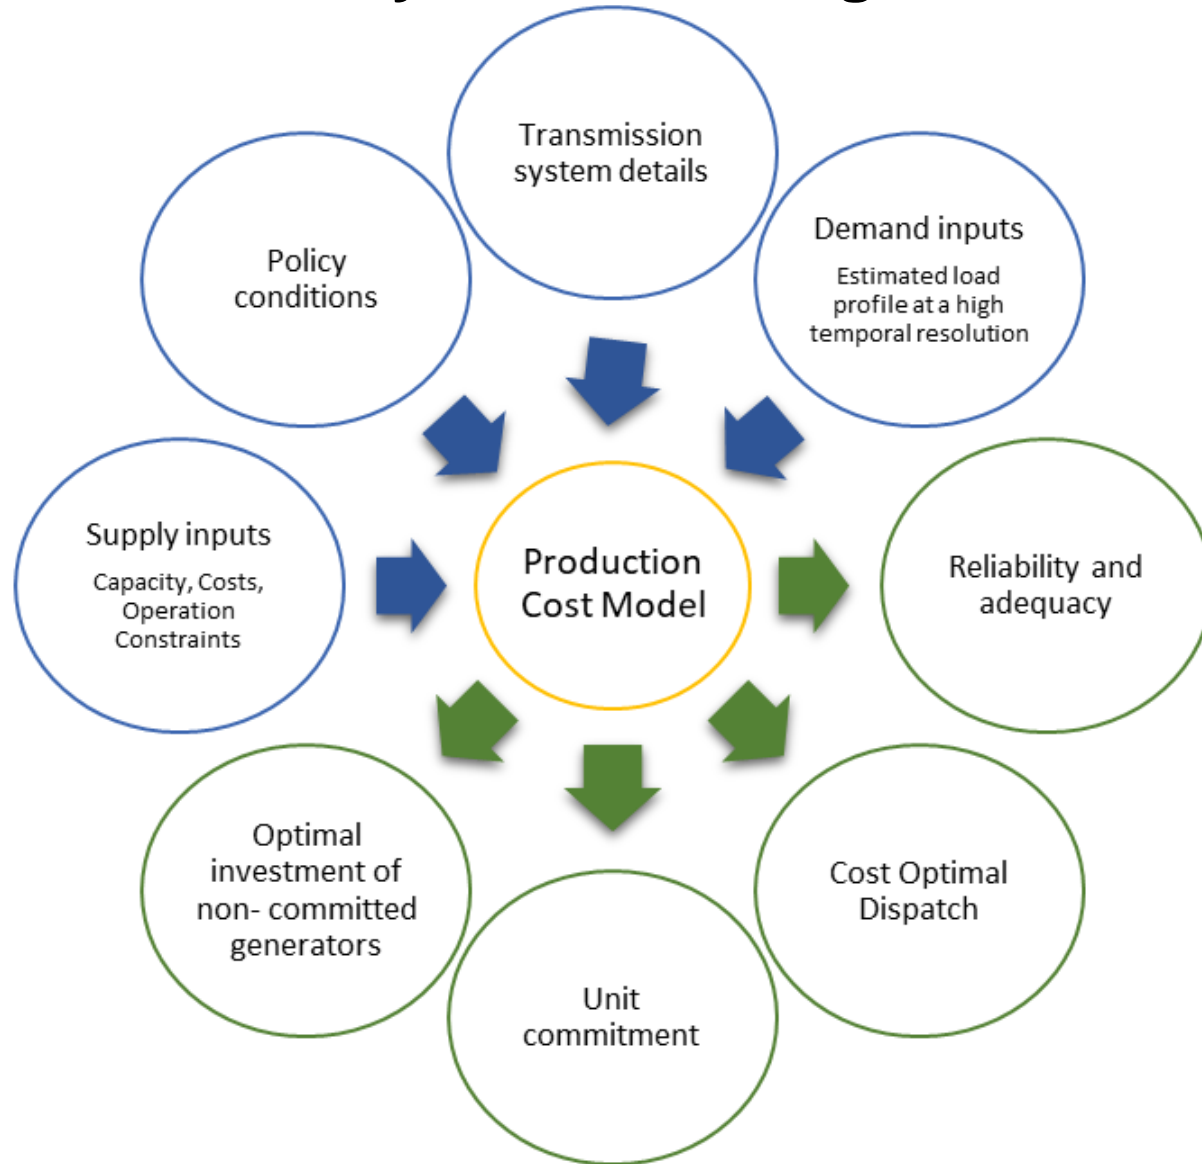

Production cost models

- are **Constrained Optimization models**
- **capture** various **costs** incurred during system operation
- both **fixed and variable** costs are considered
- adhere to **operational constraints**
- take **DC** transmission
- can operate at **high** temporal and spatial **resolution**
- output economic dispatch
- extends to security constrained unit commitment, capacity expansion or economic dispatch model

Case Study 1

Optimal Sizing for Solar-integrated Storage

Optimal Sizing of Solar Integrated Storage Project

Comprehensive Project Financial Analysis



Objective

Analyze various solar – storage configurations in terms of risks and returns and determine optimal size



Analysis Details

- For a location in Midwest USA – analyzed various storage sizes with 600 MW ac solar
- Determined long term contract price for solar-storage hybrid
- Analyzed both AC and DC coupled configurations with multiple DC/AC ratios
- Risk analysis with P50 and P90 solar output from PV System
- Debt sizing based on the contracted revenue




Outcomes


- NPV and IRR for multiple configurations and sizes
- Hourly optimal dispatch
- Determination of right DC/AC ratio
- Determination of right coupling

DC Coupled


AC Coupled

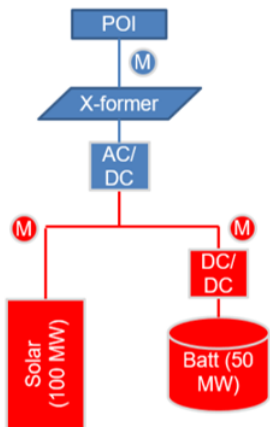


Co-located

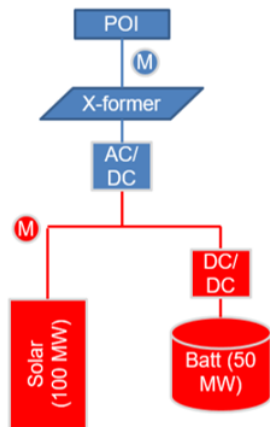

Hybrid

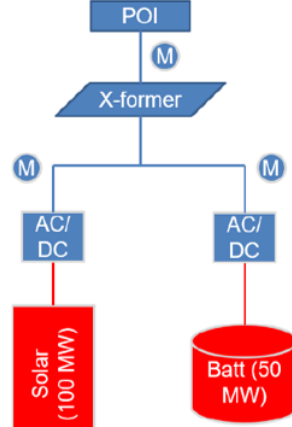


Co-located

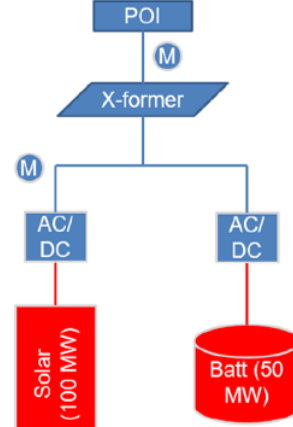


Hybrid

Key parameters for modeling

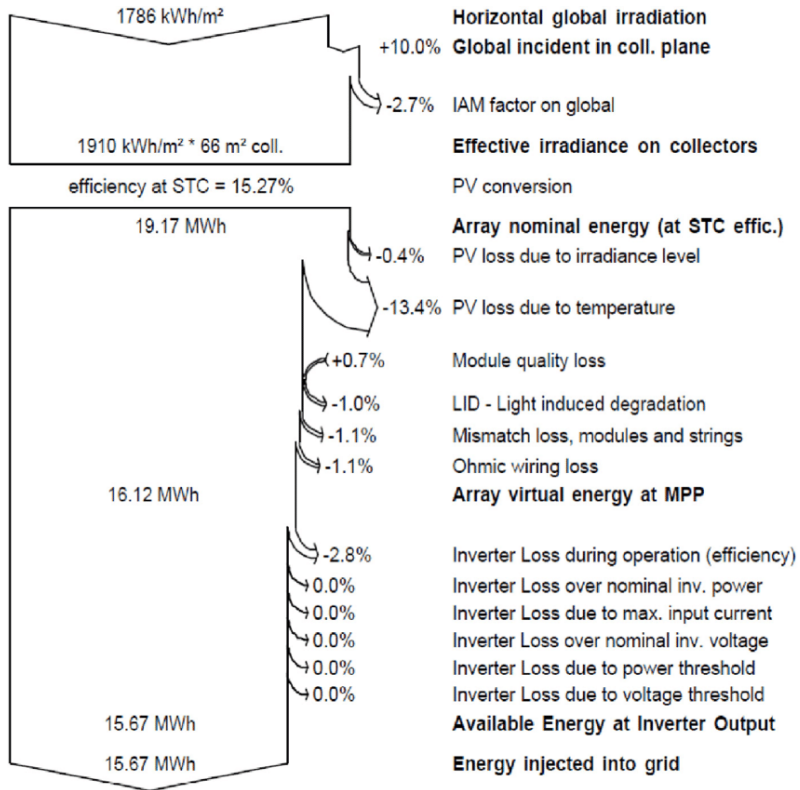

- **Solar Output:** It is critical to understand the solar output available for charging and solar output injected into the grid
- **DC/AC Ratio:** Solar is often oversized than inverter rating to increase the utilization of interconnection and to account for degradation in solar output for future years. Storage is oversized by 20 to 80%.
- **DC vs AC Coupling:** Battery utilizes clipped solar in DC coupling. DC coupling thus shows better economics but controllers for DC coupling might be expensive. AC coupling doesn't utilize clipped solar but adds flexibility to market participation.

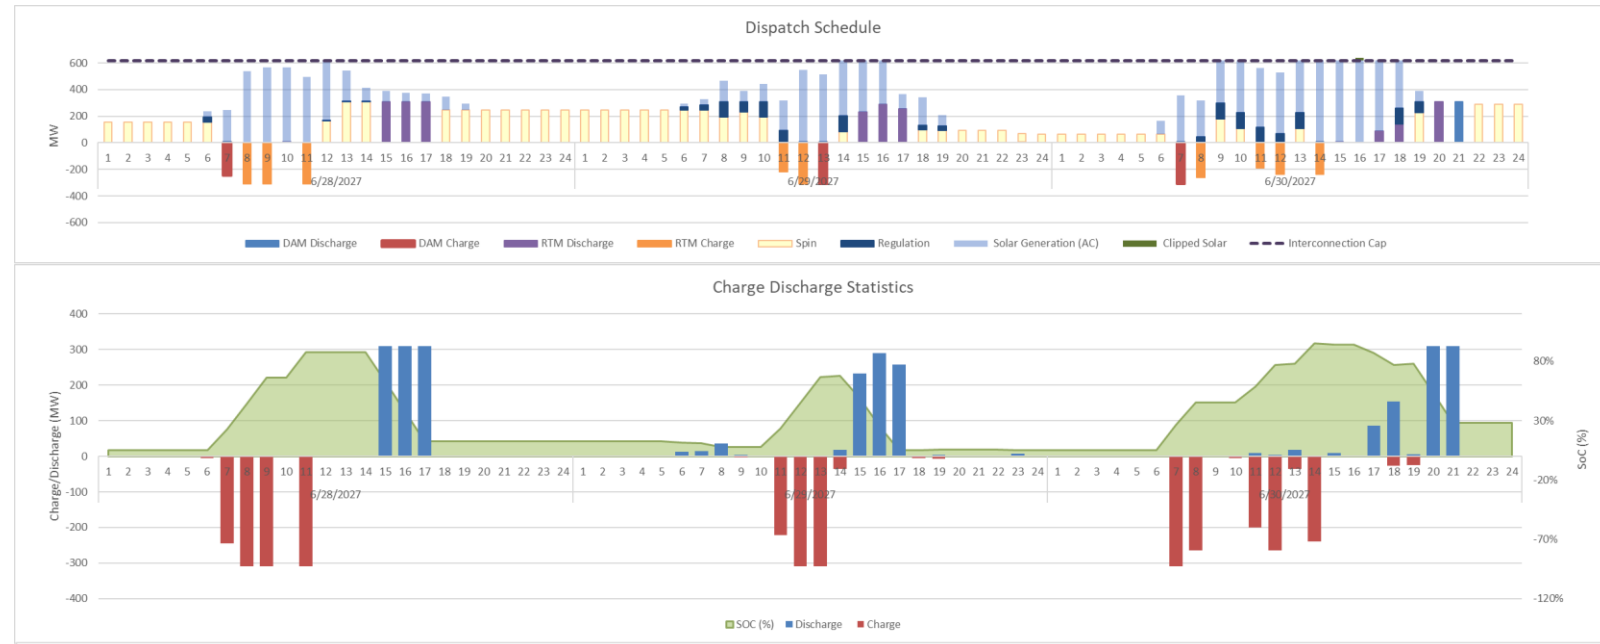

PV System – Loss Diagram

Case Study 2


Estimating Energy Storage Requirements for Tamil Nadu Grid

Optimal RE Integration in TN Grid by 2025 and 2030

ESS Requirement Analysis and Techno-Commercial Viability Study

Evolving Competitiveness of Energy Storage

Tamil Nadu can plan for high RE penetration in coming years with the help of energy storage. Firm RE power can be cost competitive with conventional generators.

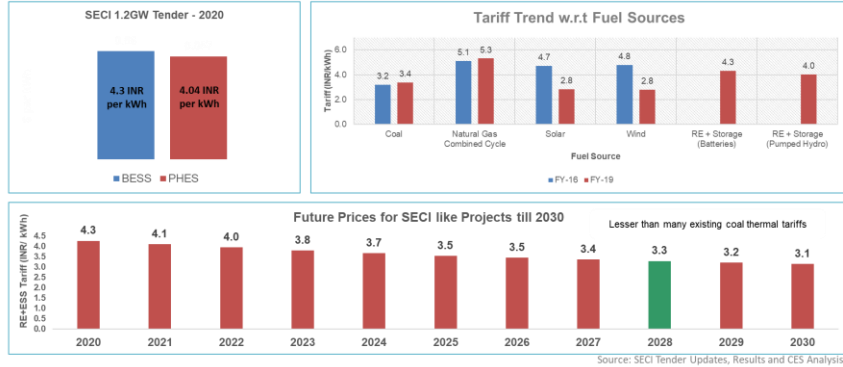

Outcomes

- Suitable energy mix for better RE integration with addition of storage
- Storage capacity requirements for in high and low RE scenarios
- System level benefits due to addition of storage
- Performance of existing assets after RE and storage



Objective


The project objective was to make an optimum renewable energy (RE) integration plan for 2025 and 2030 with the support of Energy Storage Systems (ESS) and create Energy Storage Policy Roadmap for Tamil Nadu.



Analysis Details

- Considering the increasing competitiveness of Energy storage options, a preliminary market analysis was done
- The analysis consisted two time-frames viz. 2025 and 2030, for different renewable penetration scenarios.
- Modelling consisted of two levels, an initial system level production cost analysis and then a project level study
- The economic dispatch simulation was conducted including capacity expansion of storage
- Storage plays significant role in shifting of the excess solar energy from day to evening in all seasons
- Moreover, short term variations are effectively absorbed by either charging or discharging
- Excess wind availability during monsoon and summer is used productively for nighttime or peak time supply.

Modeling Approach

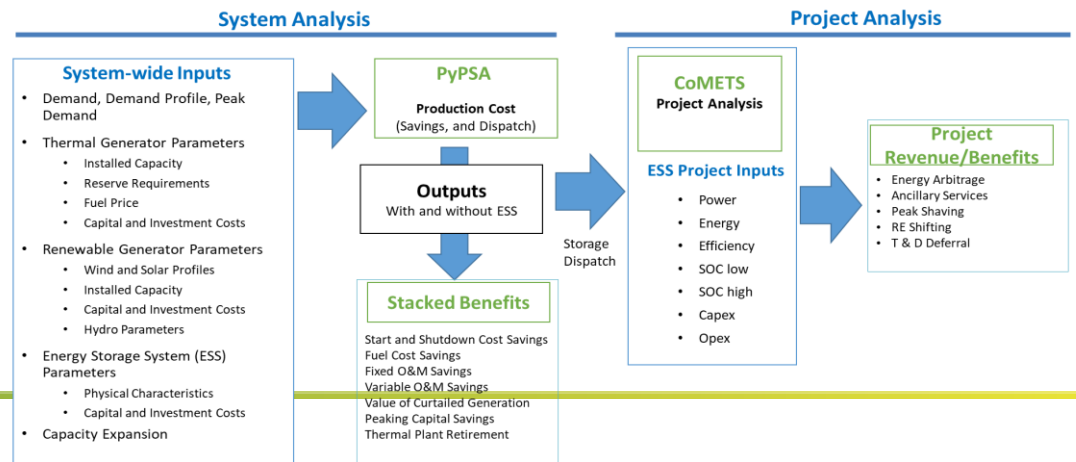


Optimal RE Integration in TN Grid by 2025 and 2030


Optimal Generation Mix 2030

- In the Optimal Generation Mix simulation, the Model takes the least cost of generation as a criteria to decide on generation Mix while keeping the RE spillage minimal.
- We see that with small addition of storage 4% of total capacity in 2025 and 6% in 2030 the level of RE integration increases from 34% to 44% in 2030.
- Also, decreases the coal share in capacity by 13%


Installed Capacity Mix Changes - Optimal Generation Mix

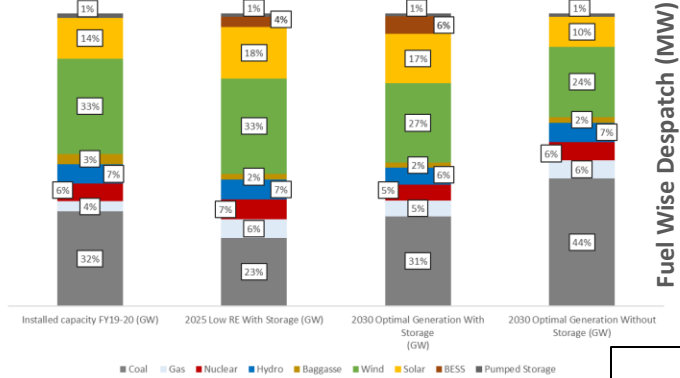


Model based example of economic dispatch showing the shifting and smoothing application of storage

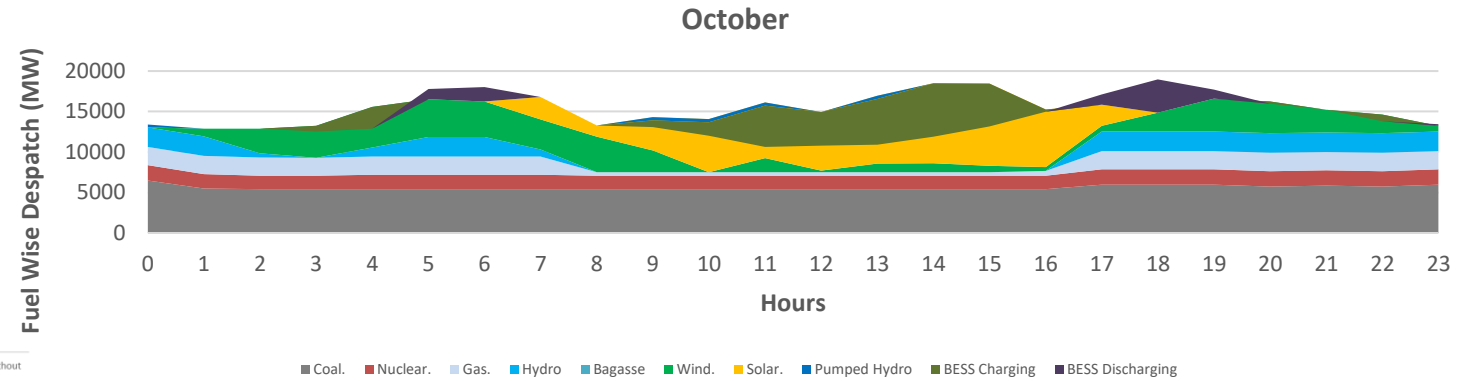

Cumulative ESS Capacity (MW) 2025 and 2030

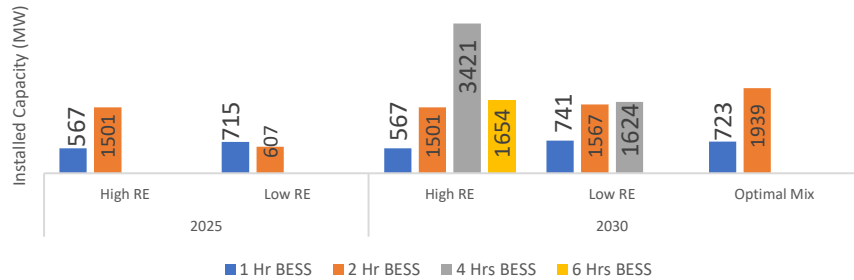

System Cost Trend - 2025 vs 2030 - Various Scenarios

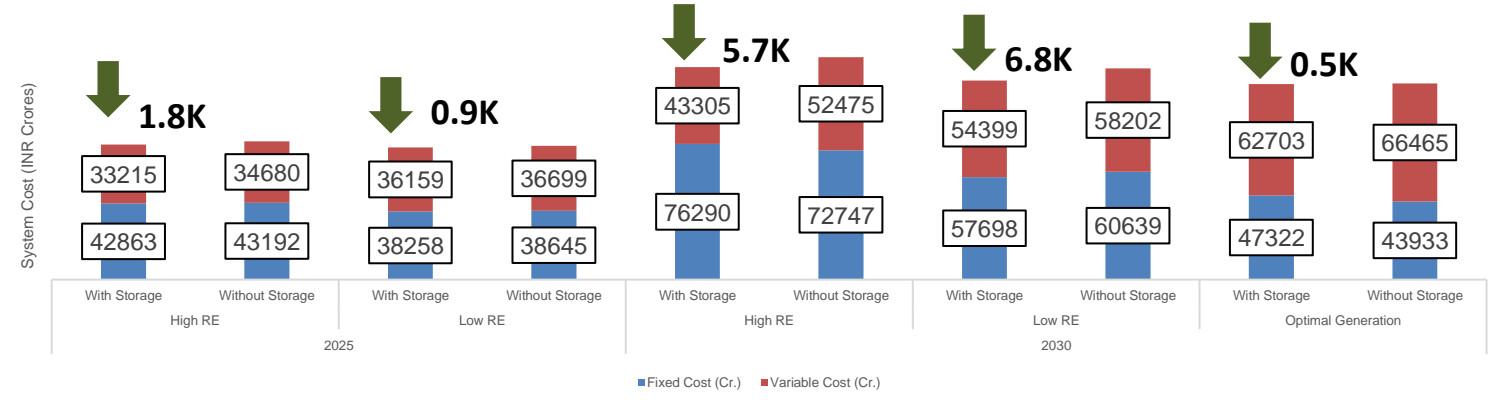


- Storage penetration in the Grid is prescribed to be Gradual
- The storage duration during the initial years are of 1 to 2 hours and the same increases to 6 hours for High RE case and 4 Hours for Low RE Case by 2030
- As per cost benefit analysis it is observed that BESS at Grid level brings maximum benefits in the 4 to 6 hours duration
- By 2030, with decrease in battery costs and improvement in technological performance, BESS will be highly competitive with new coal or gas additions

Recommendations

Case Study 3

Analysis of BESS Integration for South Andaman Electricity Grid

Analysis of BESS Integration for South Andaman Electricity Grid

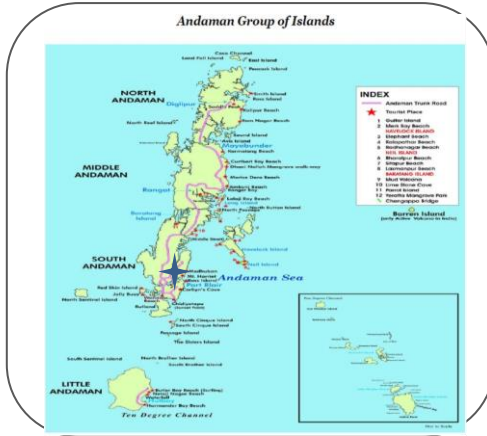




Objective

Carry out feasibility study for setting up a standalone Battery Energy Storage System (BESS) in South Andaman to arrive at an optimal solution for addressing current as well as forthcoming frequency management issues pertinent to RE integration and RE shifting for evening hours.



Analysis Details

- Production cost model was developed to assess the capacity requirements for both the purposes
- The economic dispatch was obtained at minute-level resolution
- To make the objective more tractable, days of the year were clustered based on weather volatility and were correlated with occurrence of grid interruptions
- The simulation performed capacity expansion of storage to reliably balance load at high resolution while minimizing the overall system level cost for each type of day
- Cost Savings due to addition of storage was calculated at system level, along with savings due to reduced diesel consumptions and avoided solar curtailment were also found out
- With the costs and benefits, a complete financial analysis was carried out
- Suggestions on placement and operation of the standalone BESS was also provided

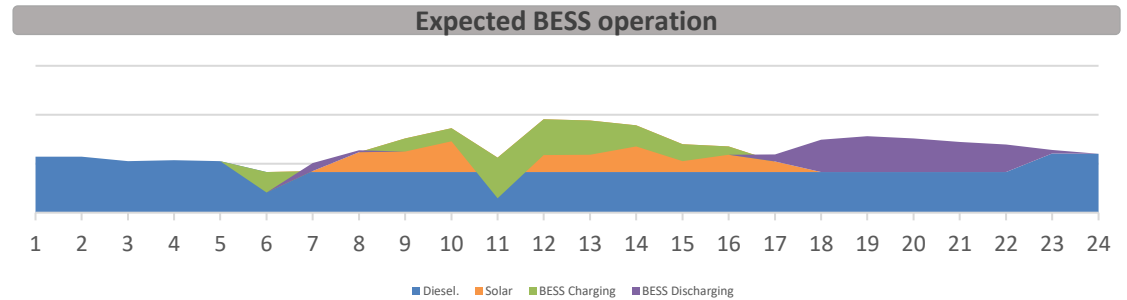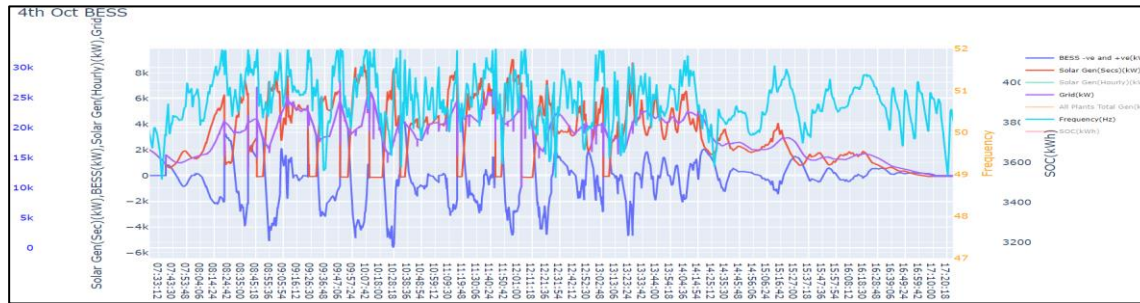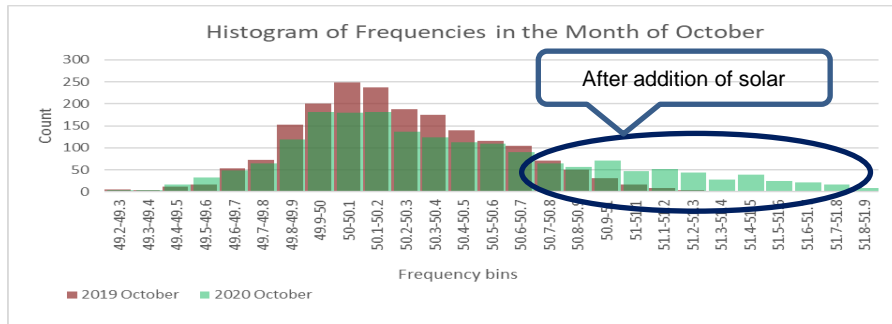


Analysis of BESS Integration for South Andaman Electricity Grid


Solar Availability





Dispatch WITHOUT storage addition

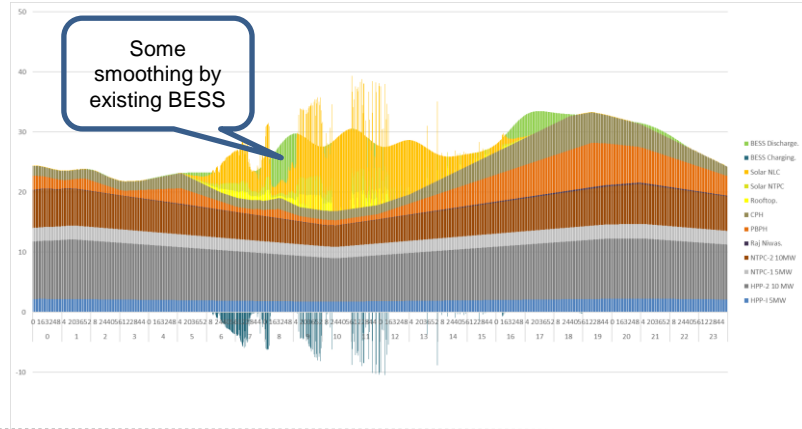

Dispatch WITH storage addition

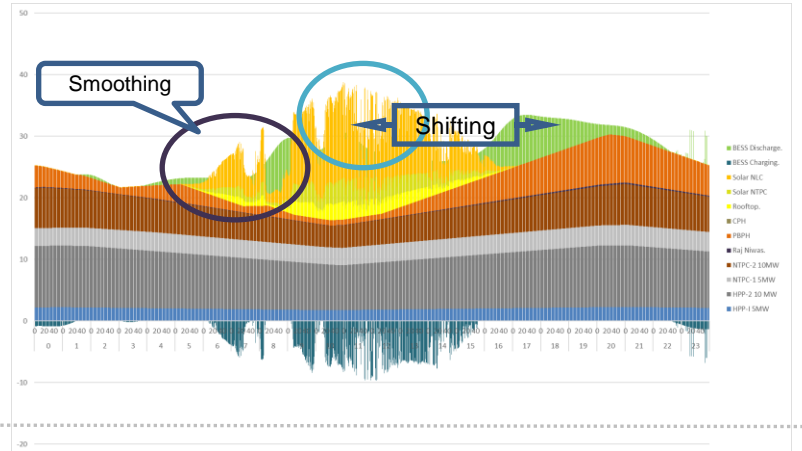

load Profile

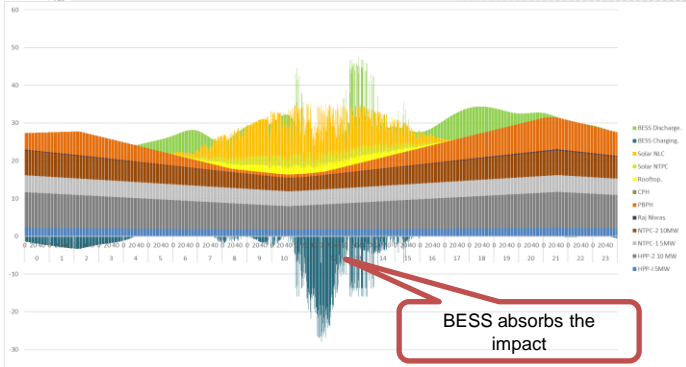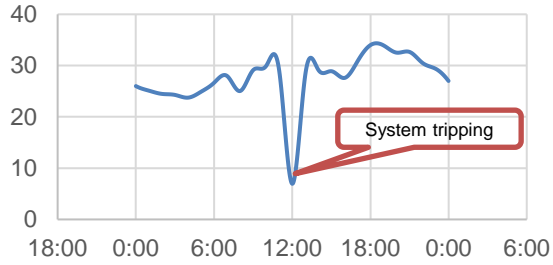

Recommendations

- Power and Energy rating of storage along with type (1-hour, 4-hour etc)
- System level benefits obtained from, with and without storage scenario comparison
- Diesel saving was reported both as liters and INR; Avoided curtailment was also reported in MWh and INR
- For the recommended sizes of storage, the possible pricing, payback period, IRR, DSCR and 10-year Net Benefits were reported
- Inputs regarding Placement and Operation of BESS were provided
- Detailed report regarding risk, safety and standards of BESS

Multiple denominations of storage type size and rating which provide the best economics, limited curtailment and diesel savings were estimated so that it can be considered as the optimal solution for South Andaman's present power system

Questions & Comments



Vinayak Walimbe
VP, Emerging Technologies
vwalimbe@ces-ltd.com

Contact us:

Customized Energy Solutions | A-501, GO Square, Aundh-Hinjewadi Link Road, Wakad, Pune -411057,
Maharashtra, India

Website: <https://ces-ltd.com/> | | www.indiaesa.info | | www.iesw.in